

ORDINANCE 476
AN ORDINANCE OF THE TOWN OF BAYFIELD COLORADO, AMENDING
CONSTRUCTION SPECIFICATIONS STANDARD DETAIL W-05

WHEREAS, Infrastructure Design Standards were adopted by Ordinance 455 on March 2, 2021; and

WHEREAS, the Board of Trustees determine it is necessary to modify certain portions of the Town's Infrastructure Design Standards regarding developer requirements for meters; and

WHEREAS, the corresponding detail to Infrastructure Design Standards Domestic Water System 3.2.7.C regarding developer requirements for meters Standard Detail No. W-05 shall be replaced with Exhibit A; and

WHEREAS, this Ordinance amends Standard Detail No. W-05 only.

BE IT ORDAINED BY THE BOARD OF TRUSTEES FOR THE TOWN OF BAYFIELD, COLORADO, THAT

Standard Detail No. W-05 to Construction Specification that corresponds to Infrastructure Design Standards Domestic Water System section 3.2.7.C shall be amended and replaced with attached hereto as Exhibit A”

Effective thirty (30) days after publish.

ADOPTED AND ORDERED PUBLISHED THIS 19th DAY OF April 2022.

The Town of Bayfield, Colorado Acting through the Bayfield Waterworks Operation

MAYOR:




Ashleigh Tarkington

ATTEST:



Kathleen S. Cathcart, Town Clerk

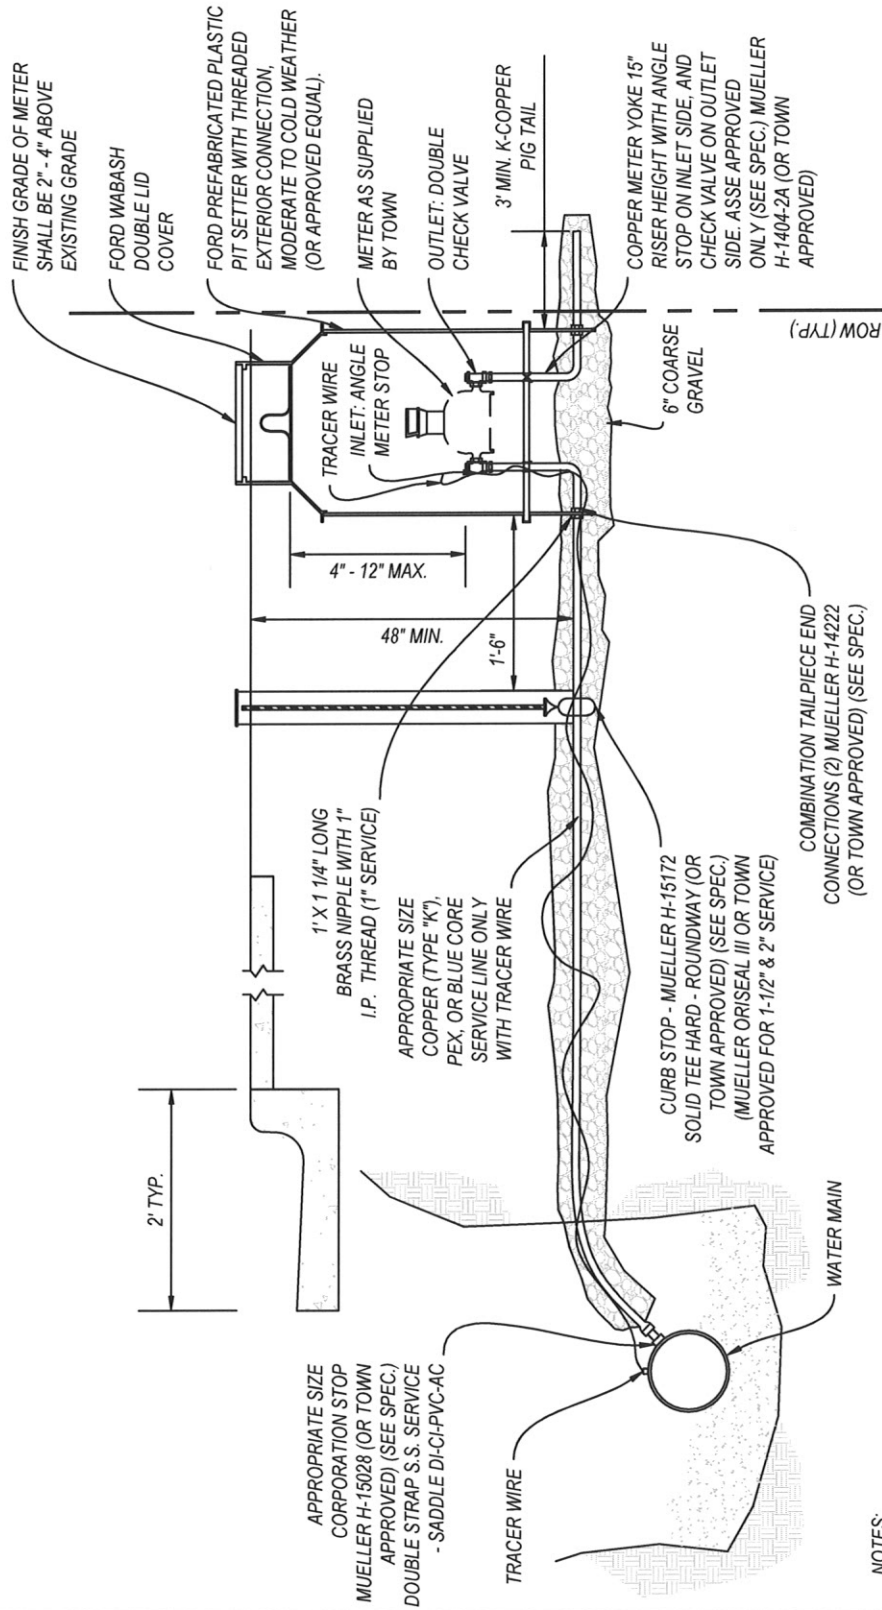

NOTES:

1. ALL SERVICE LINES TAPPED INTO EXISTING WATER LINES ARE TO BE DONE BY THE TOWN'S PUBLIC WORKS DEPARTMENT OR AUTHORIZED CONTRACTOR.
2. FOR METERS 2" OR LARGER - DETAIL DRAWINGS WILL BE SUBMITTED TO THE TOWN ENGINEER OR PUBLIC WORKS DEPARTMENT FOR APPROVAL.
3. FOR COMMERCIAL PROPERTIES WITH NO LOT LINE SETBACK, PLACE METER TWO-FOOT BEHIND CURB.
4. BOTH METER PIT AND CURB STOP MUST BE INSTALLED PLUMB AND LEVEL.
5. METER PIT AND CURB STOP MUST BE INSTALLED IN PLAIN SITE. (I.E. DO NOT LANDSCAPE AROUND OR BURY.)
6. METER PITS, METER YOKES, AND ALL FITTINGS REQUIRED FOR THE METER PIT ARE TO BE PURCHASED BY THE DEVELOPER IN ACCORDANCE WITH THE CONSTRUCTION STANDARD. THE WATER METER AND RADIO SHALL BE PURCHASED FROM THE TOWN PUBLIC WORKS DEPARTMENT ONLY.
7. IF EQUIPMENT IS DAMAGED DUE TO NEGLIGENCE; THE HOMEOWNER WILL BE RESPONSIBLE FOR ANY REPAIRS PERFORMED BY THE TOWN.
8. METER PITS ARE TO BE SET IN DESIGNATED EASEMENTS, MAINTAINED BY HOMEOWNER, AND SET A MINIMUM OF 4- FEET APART.
9. CURB STOP SHALL BE PLACED 18-INCHES IN FRONT OF THE METER PIT.
10. ALL SERVICE LINES SHALL BE BEDDED, AND COVERED A MINIMUM OF 4-INCHES ABOVE THE SET LINE WITH SAND.
11. IF A PEDESTRIAN BUFFER IS LOCATED BETWEEN THE SIDEWALK AND BACK OF CURB, THEN THE METER PITS SHALL BE PLACED IN THE BUFFER BETWEEN THE SIDEWALK AND BACK OF CURB.

CONSTRUCTION
STANDARDS

WATER SERVICE CONNECTION
5/8" X 3/4" - 1 1/2" METER

SHEET 1 OF 1

TOWN OF
BAYFIELD, CO
STANDARD DETAIL
No. W-05